





# 11-2. Centralized Controller

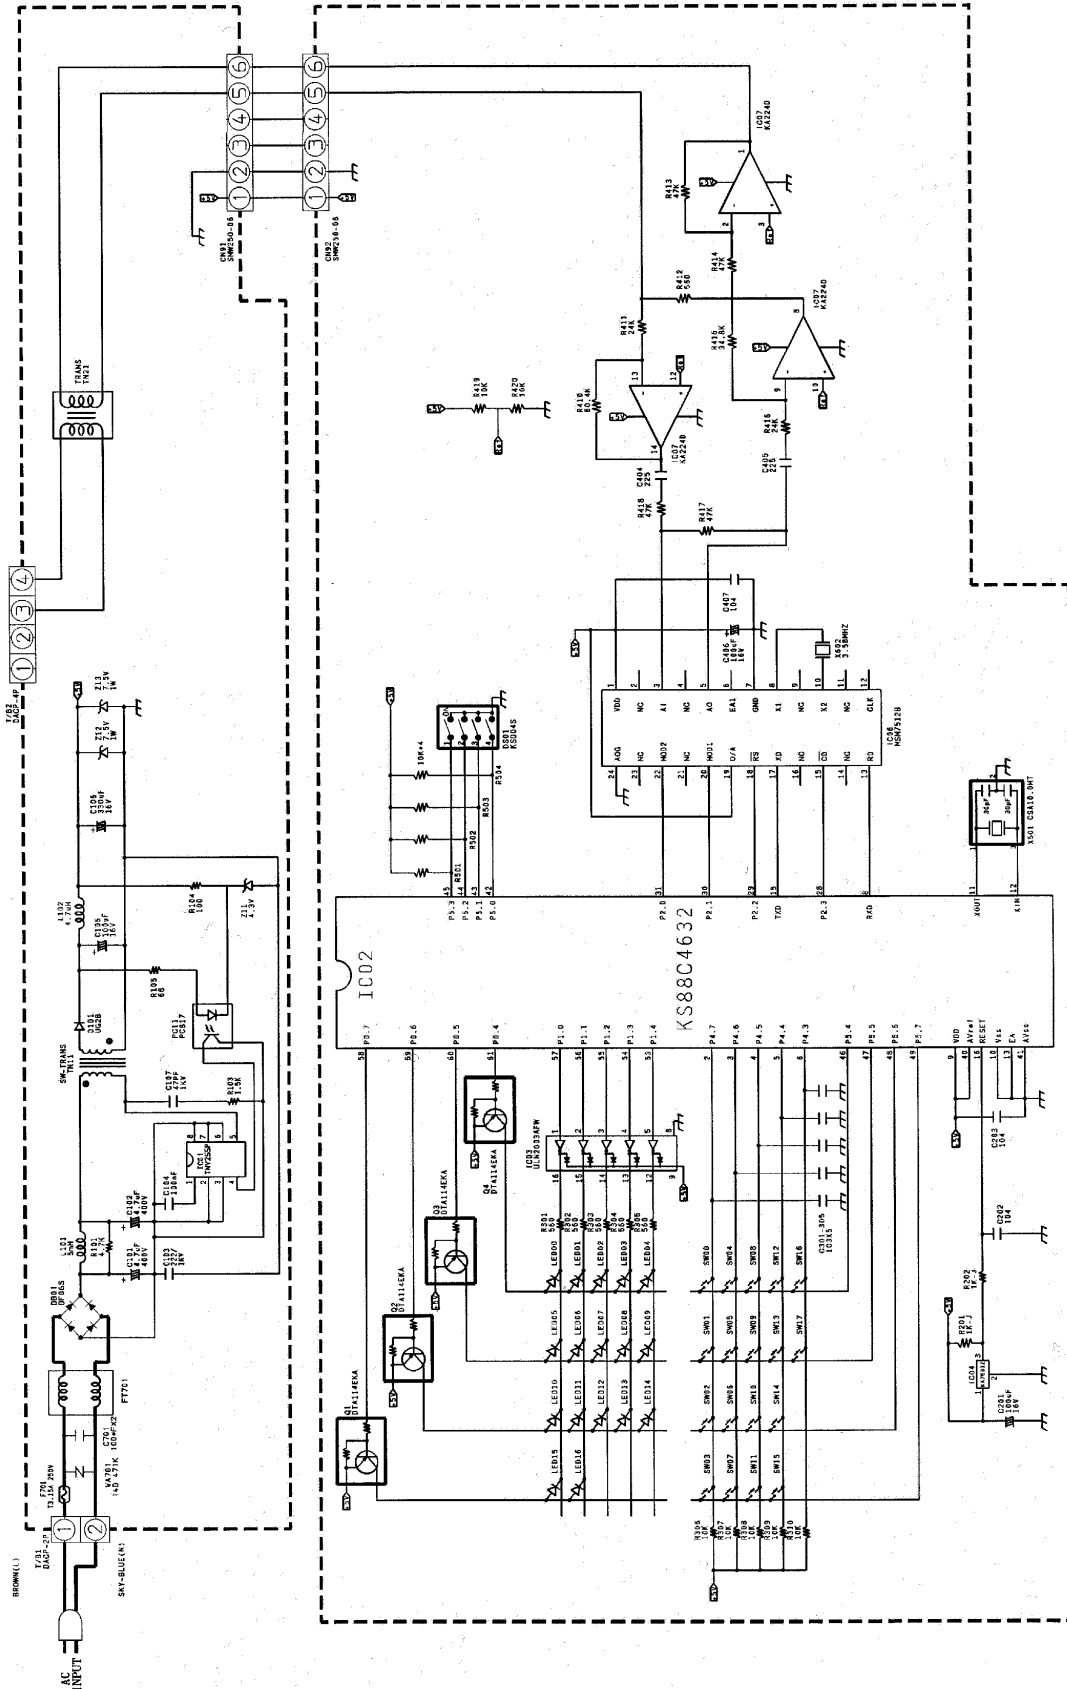


# 11-3. Indoor Unit (ADH1800E, ADH2400E, ADH3200E)

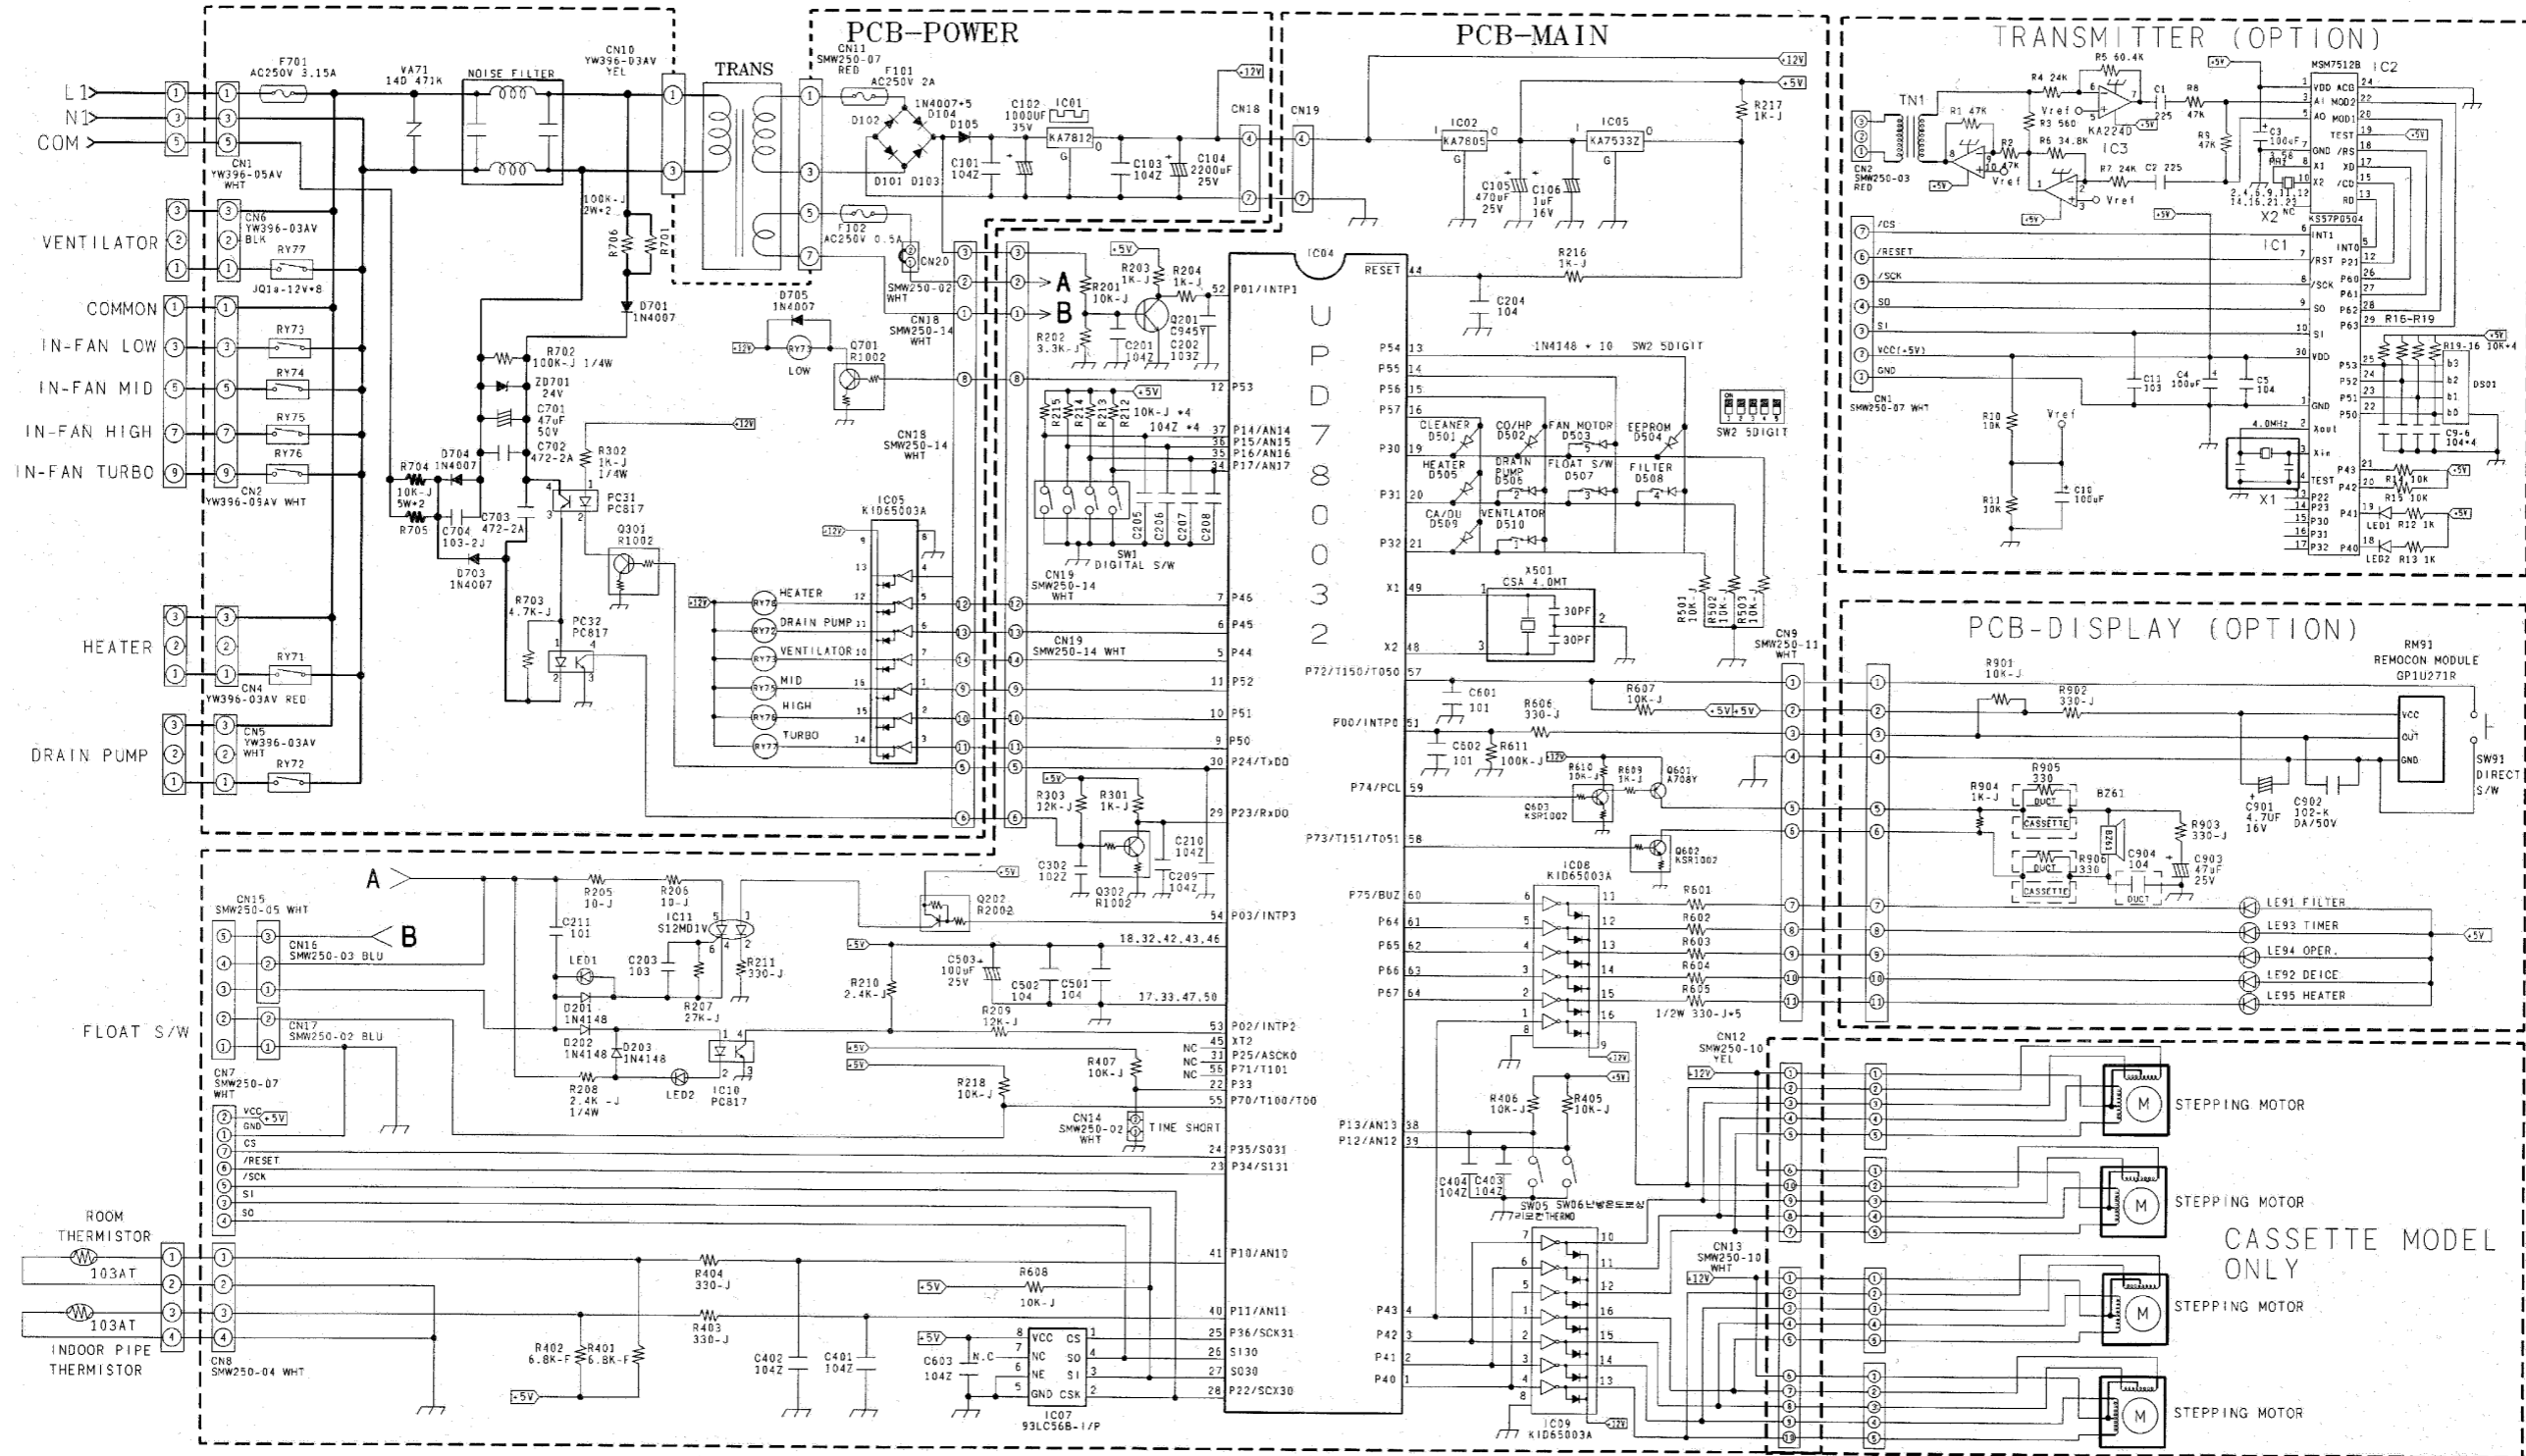

OPTION SW2	SW ON	SW OFF
1 VENTILATOR	×	○
2 DRAIN PUMP	○	×
3 FLOAT SW	○	×
4 FILTER	2000HR	1000HR
5 FAN MOTOR RPM	L/M/H	M/H/T



# 11-4. Outdoor Unit (ADH1800E, ADH2400E, ADH3200E)

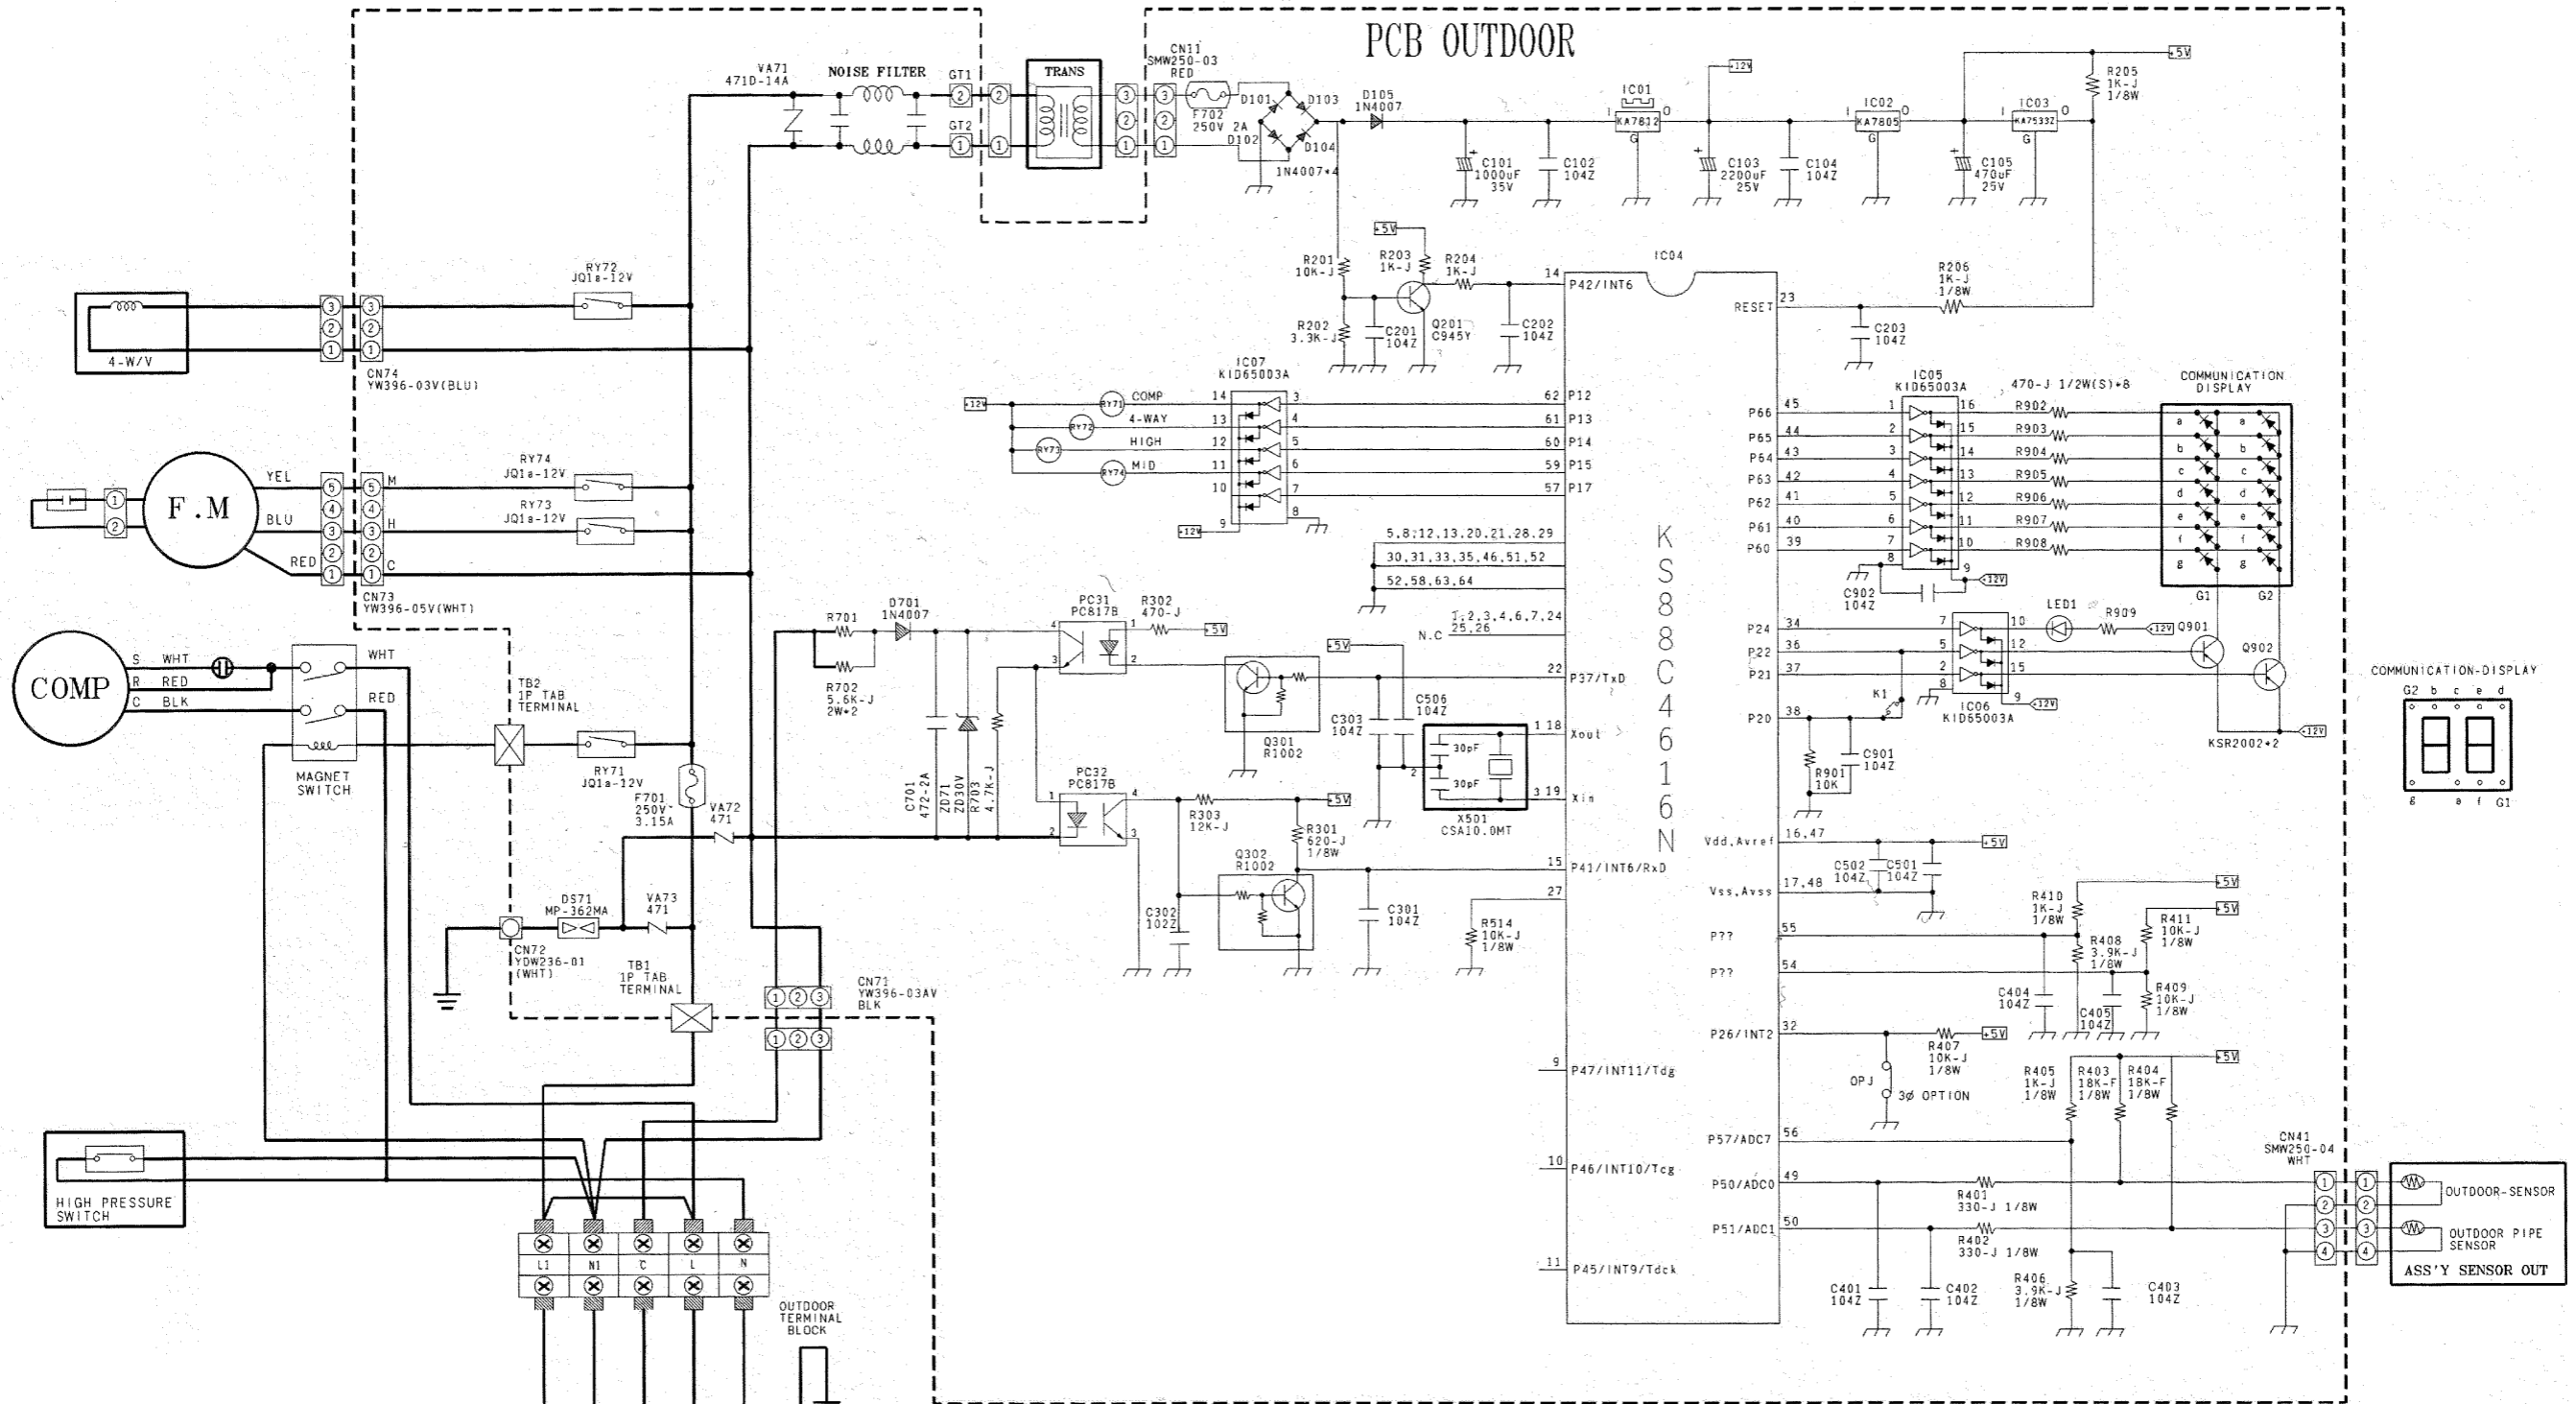

NO	MODEL	R405	R406	R408	R409	R410	R411
1	AXH1800X	1K	3.9K	3.9K	3.9K	1K	1K
2	AXH2400X	1K	3.9K	3.9K	3.9K	1K	1K
3	AXH3200X	1K	3.9K	1K	1K	3.9K	3.9K



